

1. LOCATE, CUT AND FRAME ROOF OPENINGS AS SHOWN FOR ALL HVAC EQUIPMENT AND EXHAUST FANS.

- ## **HVAC:**

- ## GENERAL NOTES

## MECHANICAL SYMBOLS

12

SCHEDULE NOTES:

- DESIGNER NOTES:

- 

## HVAC UNIT SCHEDULE

REMARKS:

- ## SUPPLY AND EXHAUST FAN SCHEDULE

NO

- ## AIR DEVICE SCHEDULE

NOTE:  
THE OUTSIDE PERCENTAGE OF TOTAL SUPPLY AIR IS 30.0% FOR RTU-1 AND 12% FOR RTU-2

## AIR BALANCE SCHEDULE CFM

FOR COMPLETE INFORMATION AND PRICING ON THE TRANE HVAC PACKAGE CONTACT MARTY CUSICK, THE YUM! BRANDS ACCOUNT EXECUTIVE AT TRANE NATIONAL ACCOUNTS.  
TOLL-FREE PHONE: (866) YUM-HVAC or (866) 986-4822  
FAX: (502) 499-7870  
EMAIL: [mjcusick@trane.com](mailto:mjcusick@trane.com)

TACO BELL HAS A NATIONAL HVAC AGREEMENT WITH LENNOX NATIONAL ACCOUNTS. FOR QUOTES & TECHNICAL SPECIFICATIONS CONTACT BY EMAIL AT YUM!@LENNOXIND.COM OR 800-367-6285 ACCOUNT MANAGER BRAD SMITH.

TRANE AND LENNOX HAVE AGREED TO SUPPLY AN HVAC PACKAGE CONSISTING OF THE ROOF-TOP UNITS, CURBS, THERMOSTATS, TEMPERATURE SENSORS (REMOTE), AND HUMIDITY SENSORS (REMOTE). RTUS AS SPECIFIED INCLUDE AN UNPOWERED CONVENIENCE OUTLET (SEE ELECTRICAL) AND AN HACR CIRCUIT BREAKER WHICH PROVIDES UNIT DISCONNECT. TRANE AND YORK ALSO HAVE AVAILABLE OPTION PACKAGES WHICH INCLUDE SMOKE DETECTORS AND ANNUNCIATORS, ECONOMIZERS, AND RTU VARIATIONS SUCH AS HIGH-EFFICIENCY MODELS.




FOR HVAC TEST AND BALANCE, GC TO SCHEDULE WITH TACO BELL'S PREFERRED VENDOR PER SCOPE OF WORK WORKSHEETS.

BE PREPARED AT TIME OF ORDER OR QUOTE REQUEST TO PROVIDE ALL PROJECT DETAILS REGARDING SPECIFICATIONS AND QUANTITIES AS SITE SPECIFIC DESIGN MAY NOT MATCH NATIONAL DESIGN.

SEE THE SCOPE OF WORK SHEETS FOR ADDITIONAL INFORMATION.



5.19.22

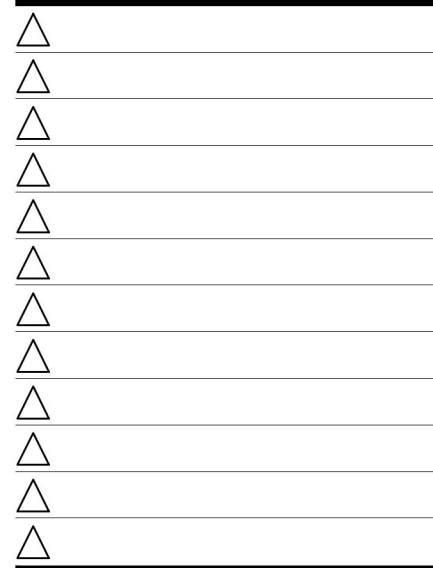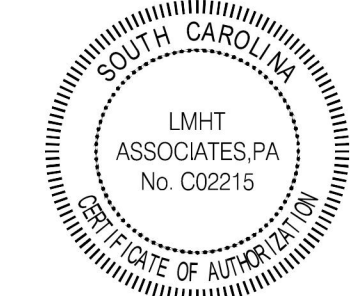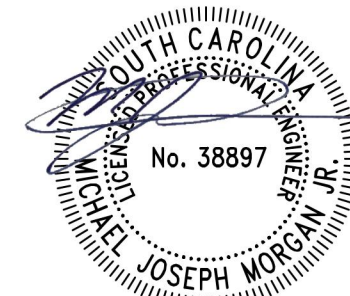

CONTRACT DATE: XXXXX

BUILDING TYPE: XXXXX

PLAN VERSION: XXXXX

SITE NUMBER: 315669

STORE NUMBER: XXXXX

TACO BELL

SPEARS CREEK CHURCH RD  
ELGIN, SC 29045



# ENDEAVOR 2.0

# MECHANICAL SCHEDULES AND NOTES

# M1.0